


NOTES:

1. THIS INSTALLATION REQUIRED FOR SERVICE TO A MOBILE HOME
2. AVEC TO PROVIDE GUY AND ANCHOR INSTALLATION FOR SERVICE SPANS EXCEEDING 75 FT.
3. AS A LESS PREFERRED ALTERNATIVE TO THE USE OF AN OFFSET NIPPLE AND CONDUIT STRAPS, STANDOFF BRACKETS ARE ACCEPTABLE. EACH STANDOFF BRACKET REQUIRES THE FOLLOWING ITEMS:
 - (1) STANDOFF BRACKET (LLR #LR85DB, WGS #WA85DB)
 - (1) 2" CONDUIT CLAMP (KDF #C-105-2)
 - (4) 1/2" x 4" LAG SCREWS

CHECK BOX WHEN COMPLETE

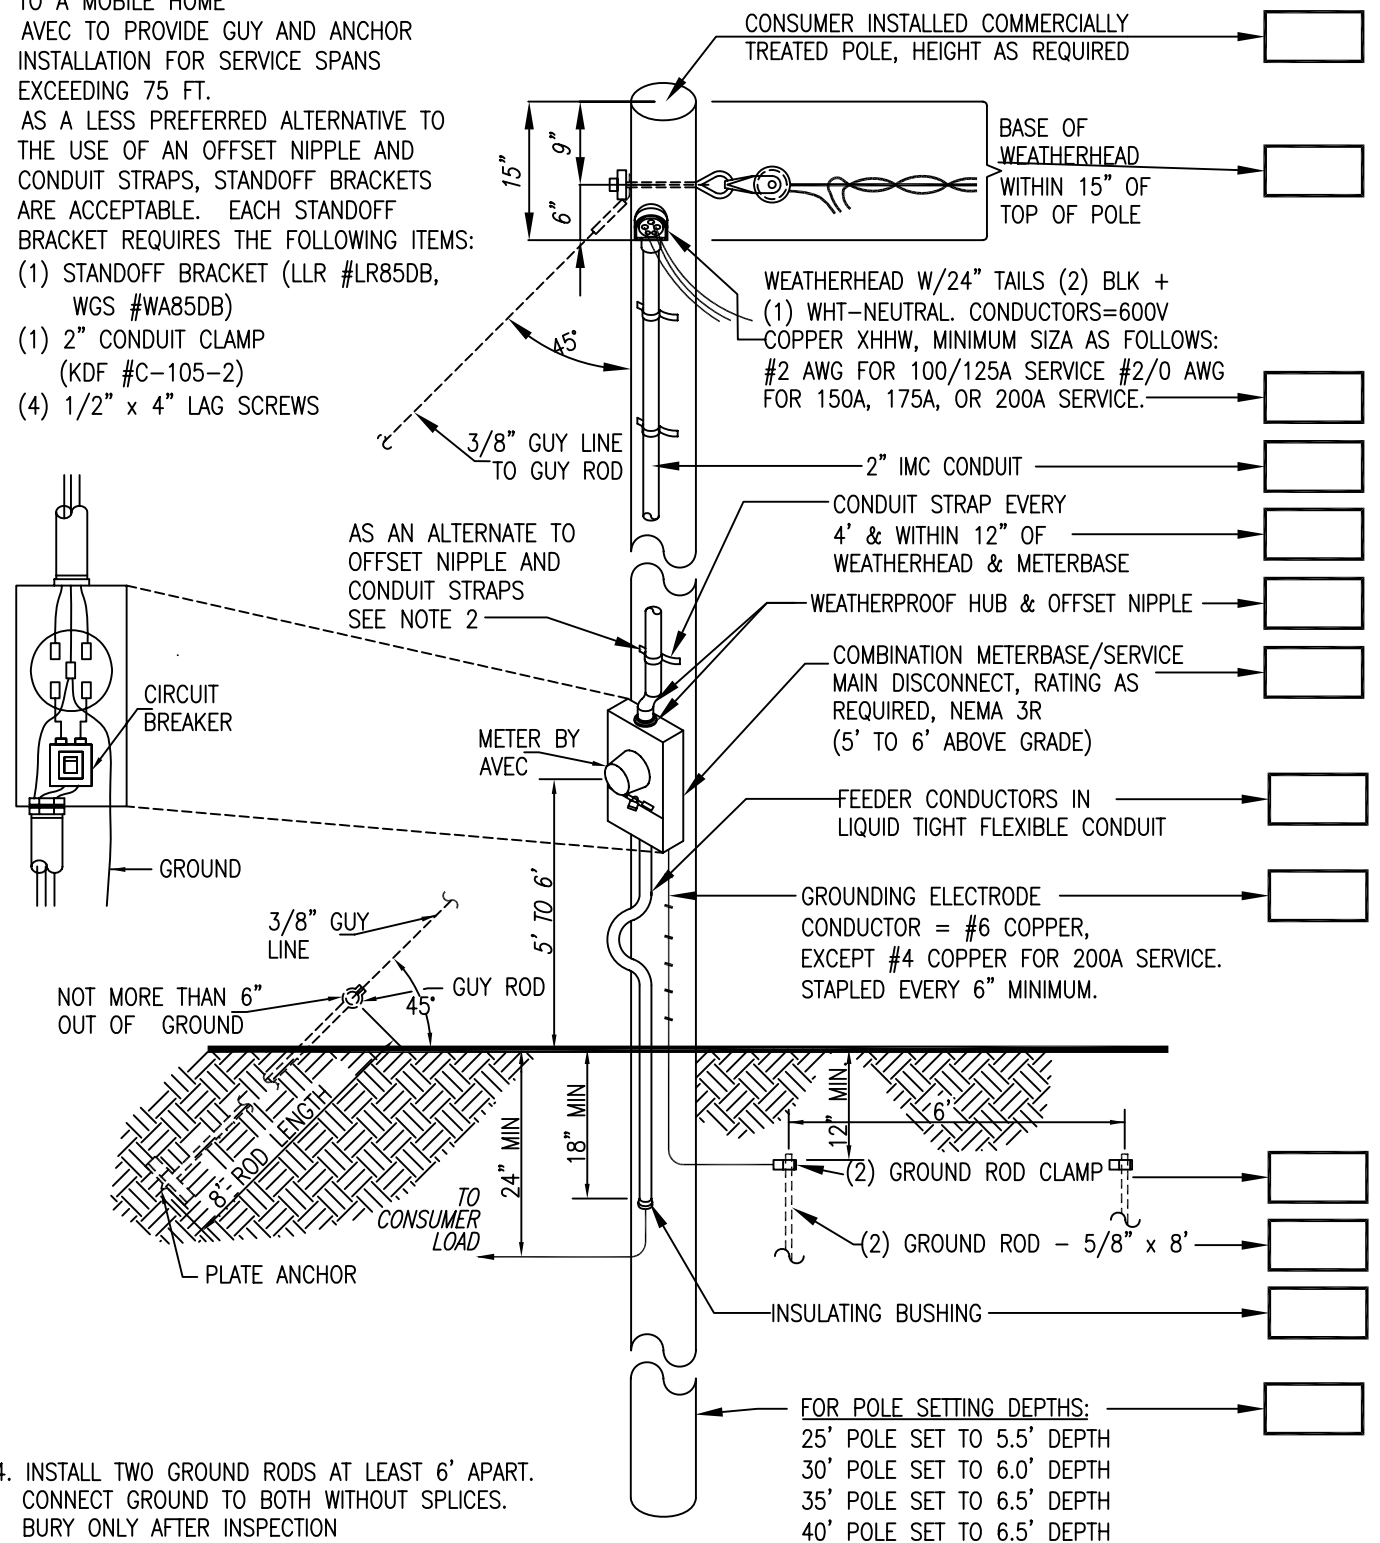

4. INSTALL TWO GROUND RODS AT LEAST 6' APART. CONNECT GROUND TO BOTH WITHOUT SPLICES. BURY ONLY AFTER INSPECTION

DATE 3-12-04
REV. 7

ALASKA VILLAGE ELECTRIC CO-OP
DISTRIBUTION ASSEMBLY GUIDE DRAWING

SERVICE TO
CONSUMER OWNED METER POLE

APPLICATION 240VAC 1Ø SERVICE	DWG. R. MONAHAN ENGR. W.A.S.	ACCT. NO.	SPEC. NO.	CAD# 93-3A	SHT 1 of 1
----------------------------------	---------------------------------	-----------	-----------	---------------	---------------