


IMPORTANT: THESE ITEMS MUST ALL BE FOLLOWED OR THE LINEMAN CAN NOT HOOK UP YOUR SERVICE

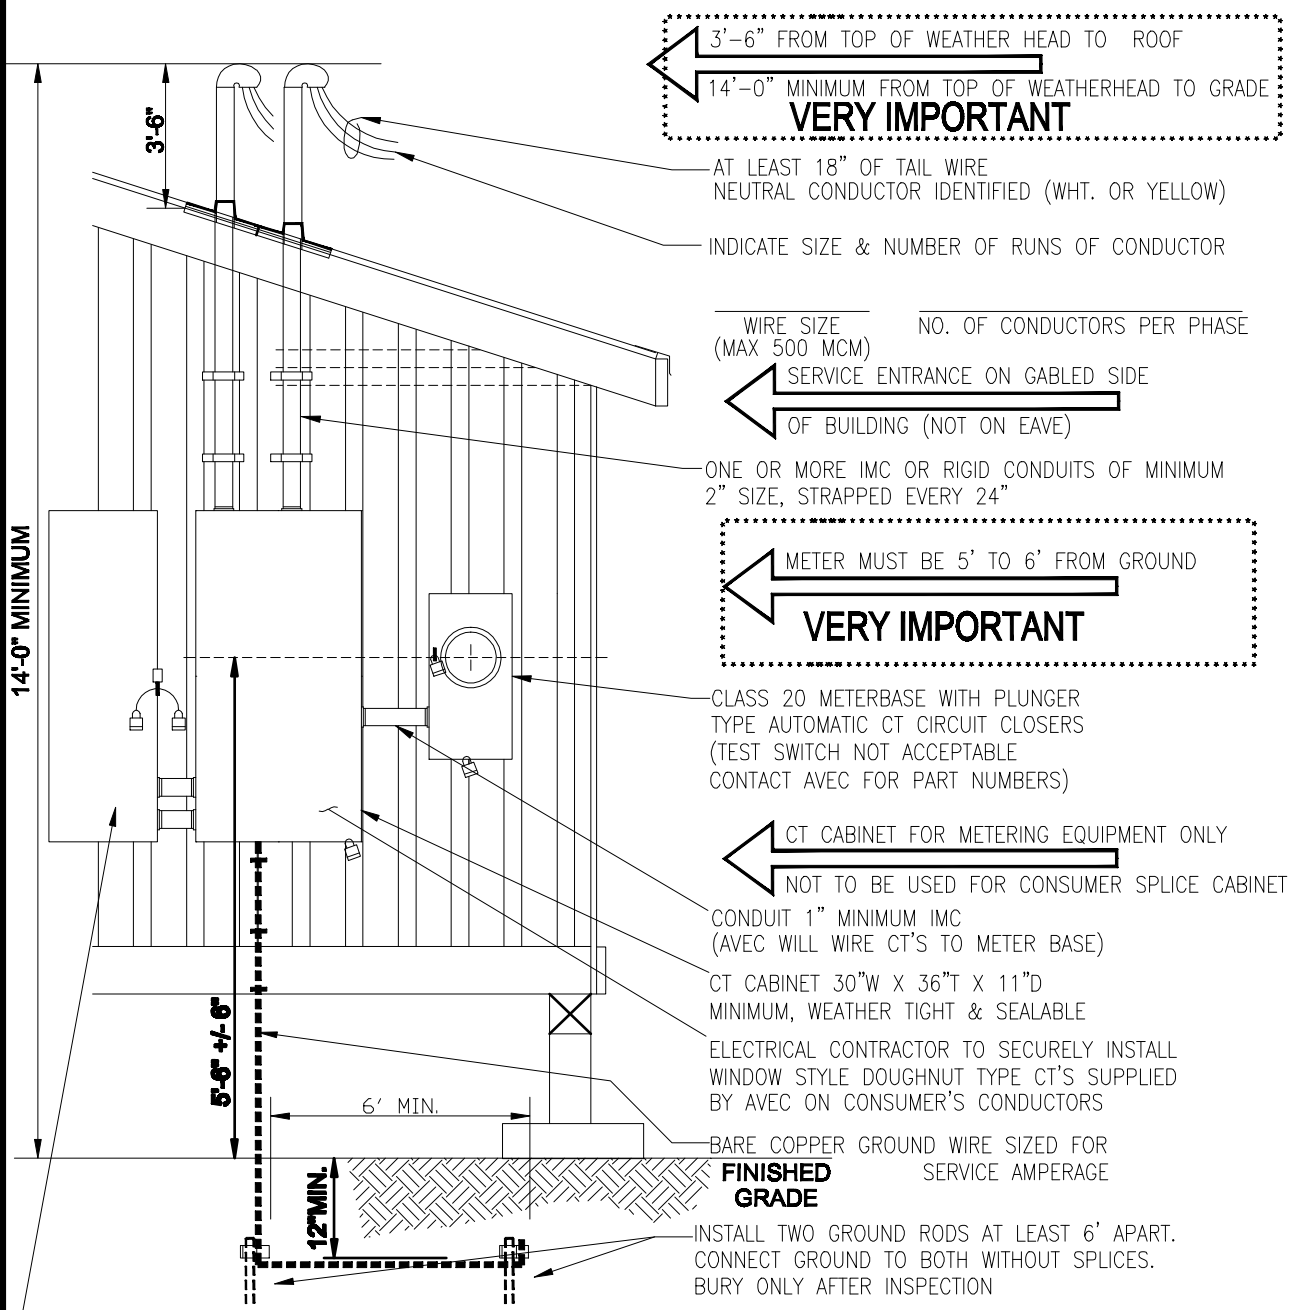

CHECK IF COMPLETE

OUTSIDE DISCONNECT SWITCH MUST BE FUSED OR SOLID BLADE TYPE MUST BE SECURED WITH AVEC LOCK

WHEN YOUR SERVICE ENTRANCE MATCHES THIS DIAGRAM RETURN THIS FORM TO AVEC OPERATIONS - 1800-959-0324

CALL THE OPERATIONS DEPARTMENT AT 1-800-478-1818 OR EMAIL TO: operations@avec.org IF YOU HAVE ANY QUESTIONS.

INSPECTED BY _____ DATE _____

ALASKA VILLAGE ELECTRIC CO-OP
DISTRIBUTION ASSEMBLY GUIDE DRAWING

DATE 10-31-06
REV. 2

SERVICE ENTRANCE INSPECTION FORM - CT METERING, LARGER THAN 200A

NAME _____ W.O.# _____

APPLICATION TRANSFORMER RATED SERVICES > 200A	DWG. T. DIBBLE ENGR. W.R.S.	ACCT. NO.	SPEC. NO. AVEC-NSI	CAD# D2004-28	SHT 1 of 1
---	--------------------------------	-----------	-----------------------	------------------	---------------